

AK Controls Ltd

Safe Water Monitoring

Automatic Report


Bournemouth Learning Centre
Ensburry Avenue
Bournemouth
BH10 4HG

Station Date/Time: 29-May-18 8:00 AM BST
Station MAC Address: 00:10:70:00:62:53
Reporting Period: Weekly

Flow Maximum Temperature	Flow Minimum Temperature	Flow Average Temperature
68.50	38.32	49.33


Below are records over the past week in graph and tabular form relivant to dometic hot water temperatures.

DHWS Flow temperatures

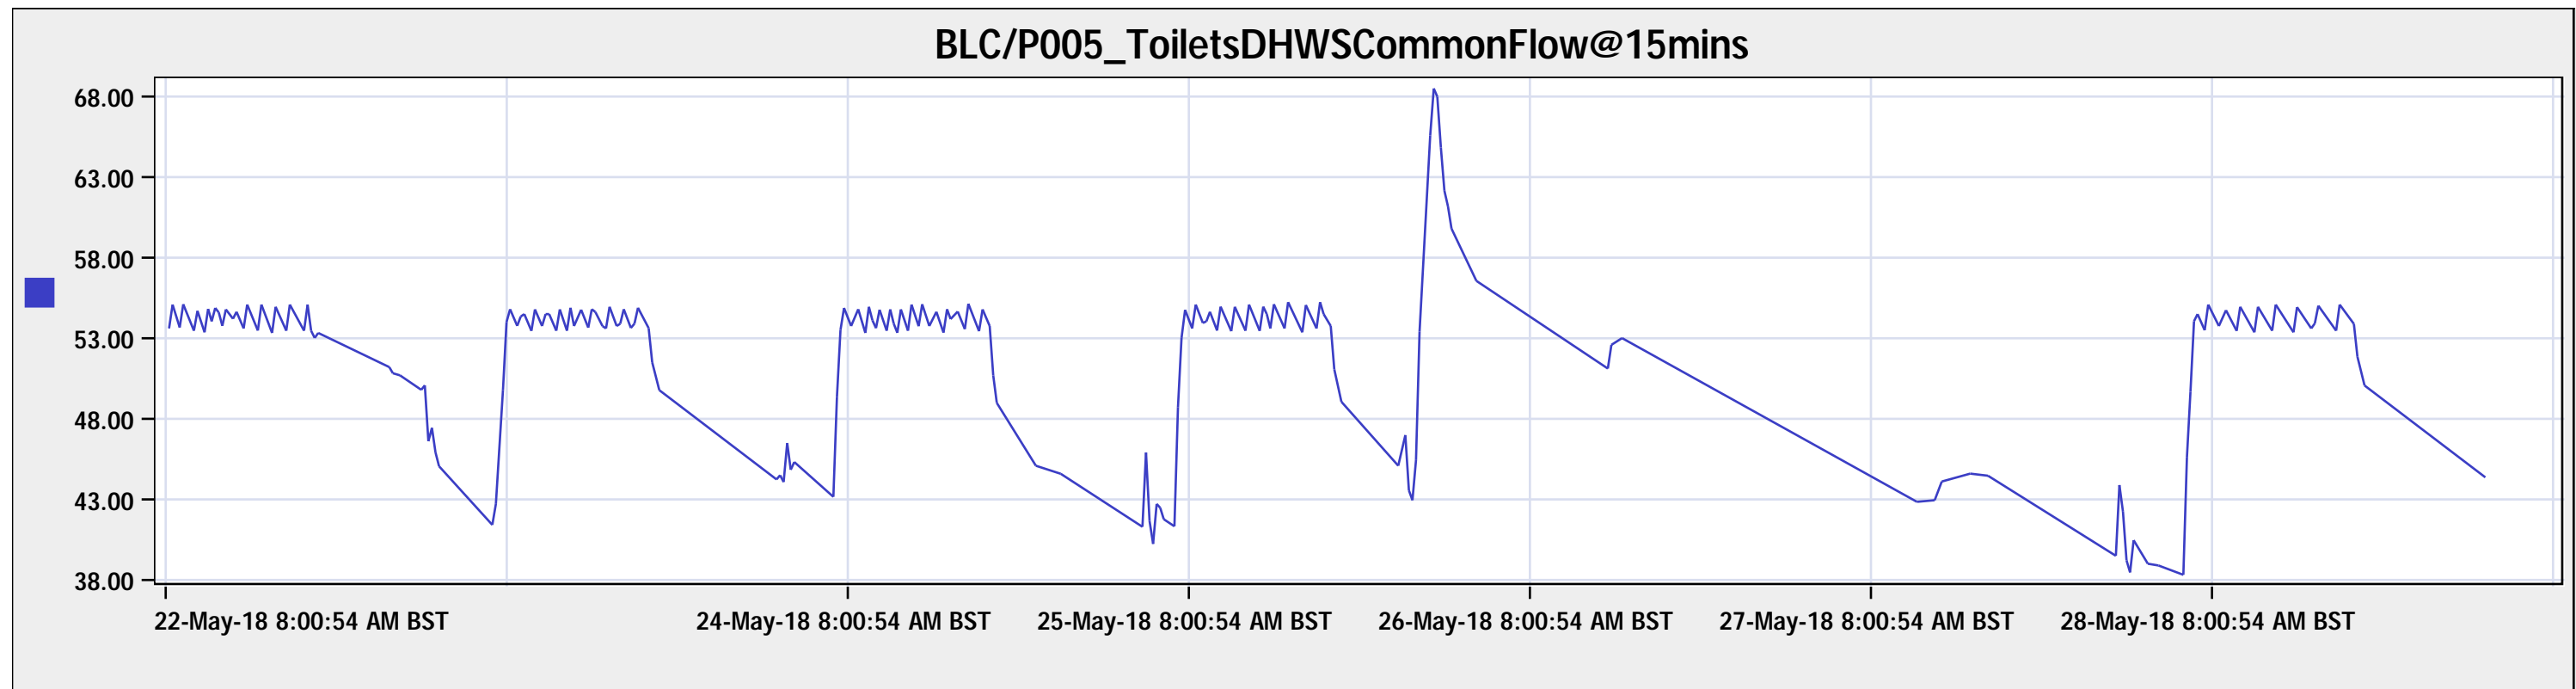


29-May-18 8:00 AM BST


DHWS Return Temperatures

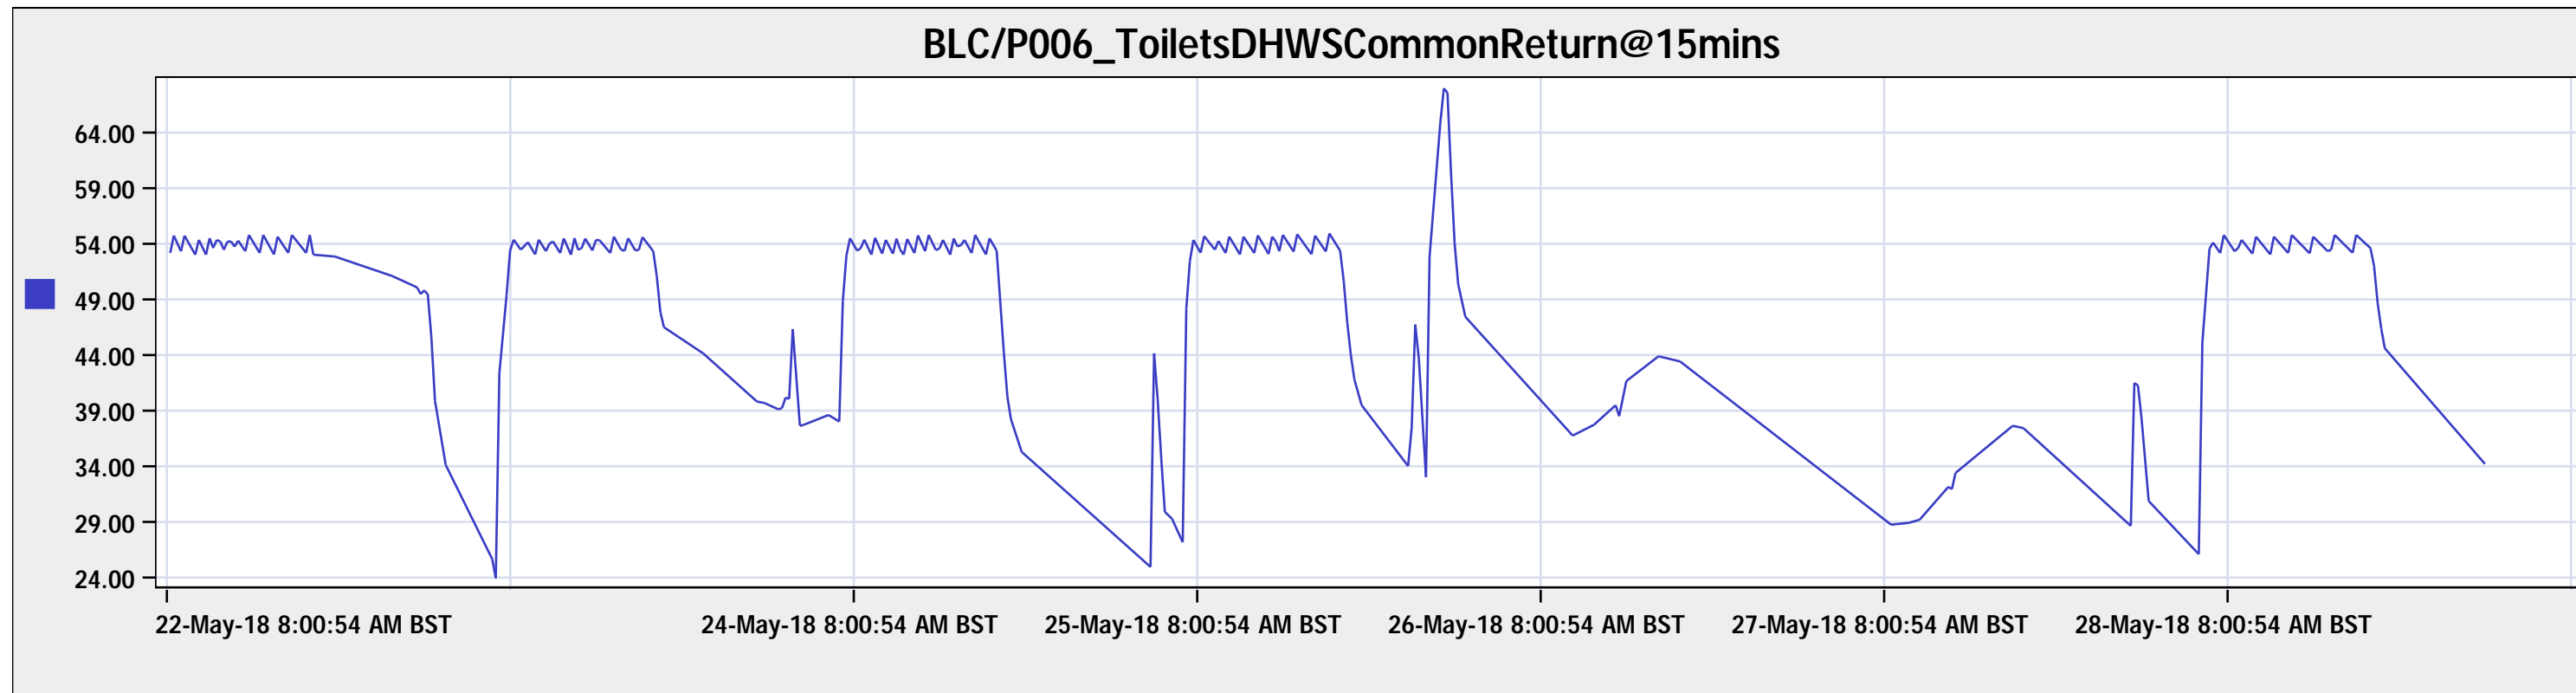


DHWS Toilets Tank1 Flow

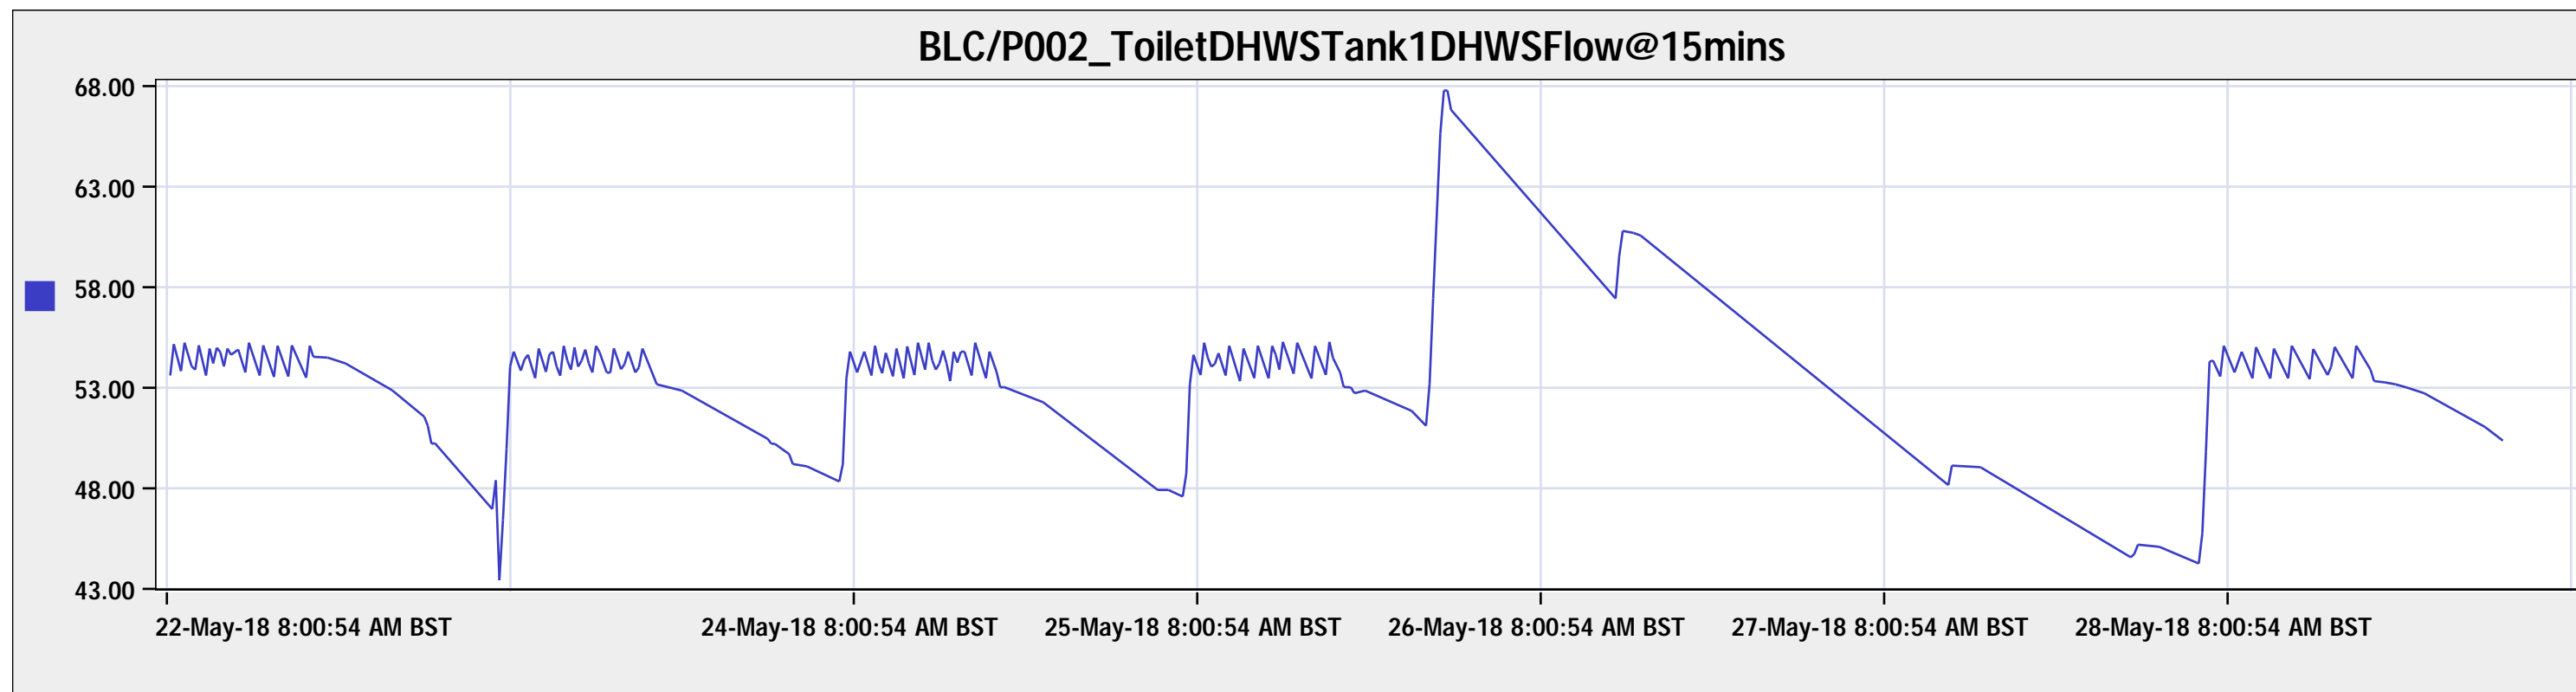


DHWS Toilets Tank2 Flow

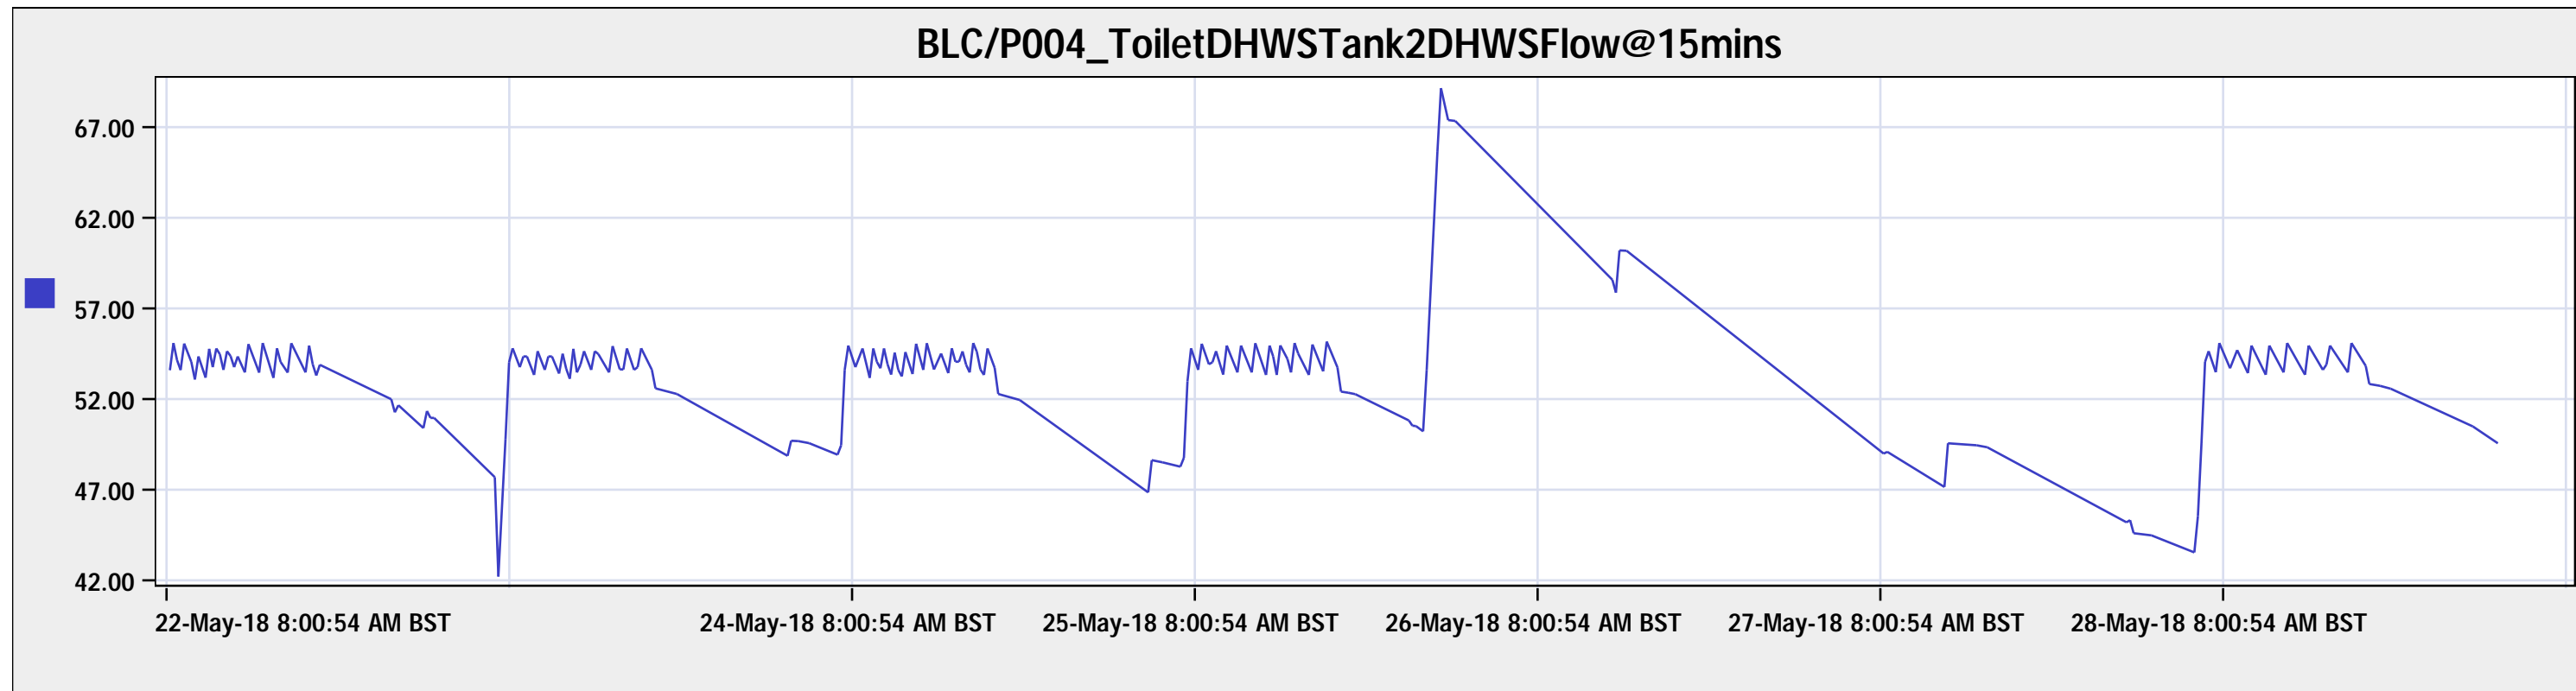

DHWS Toilets Tank1 Cold Feed

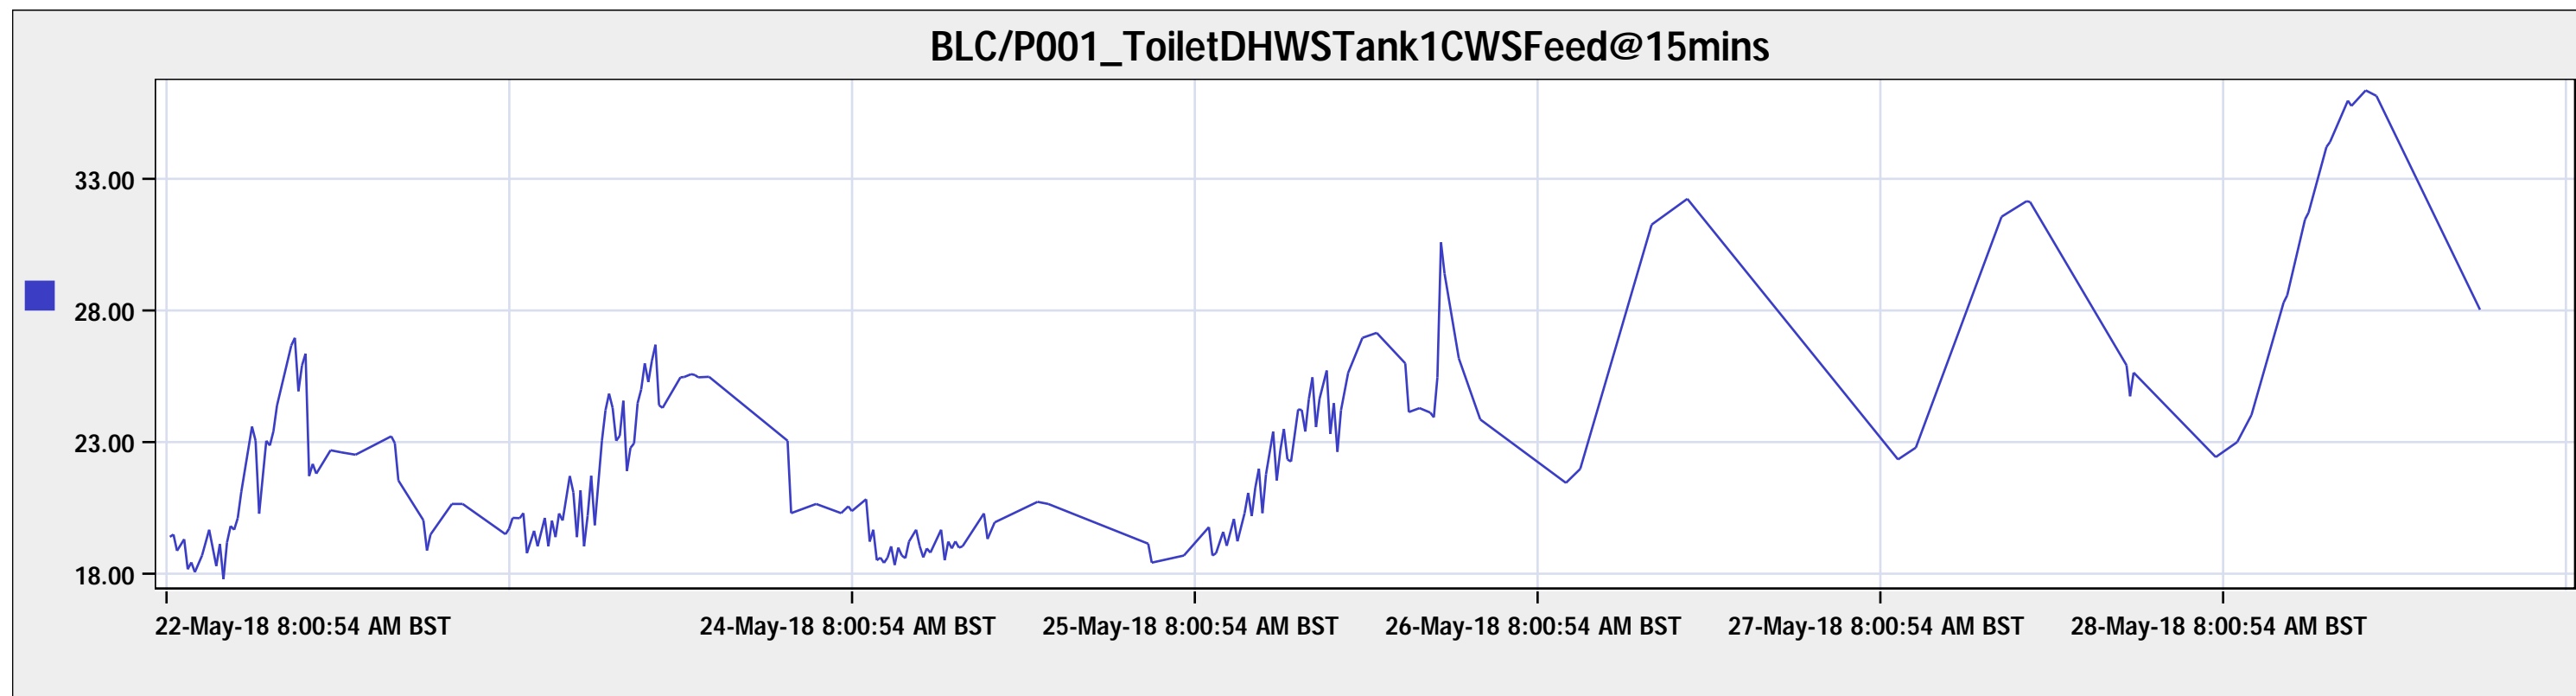

DHWS Toilets Tank2 Cold Feed

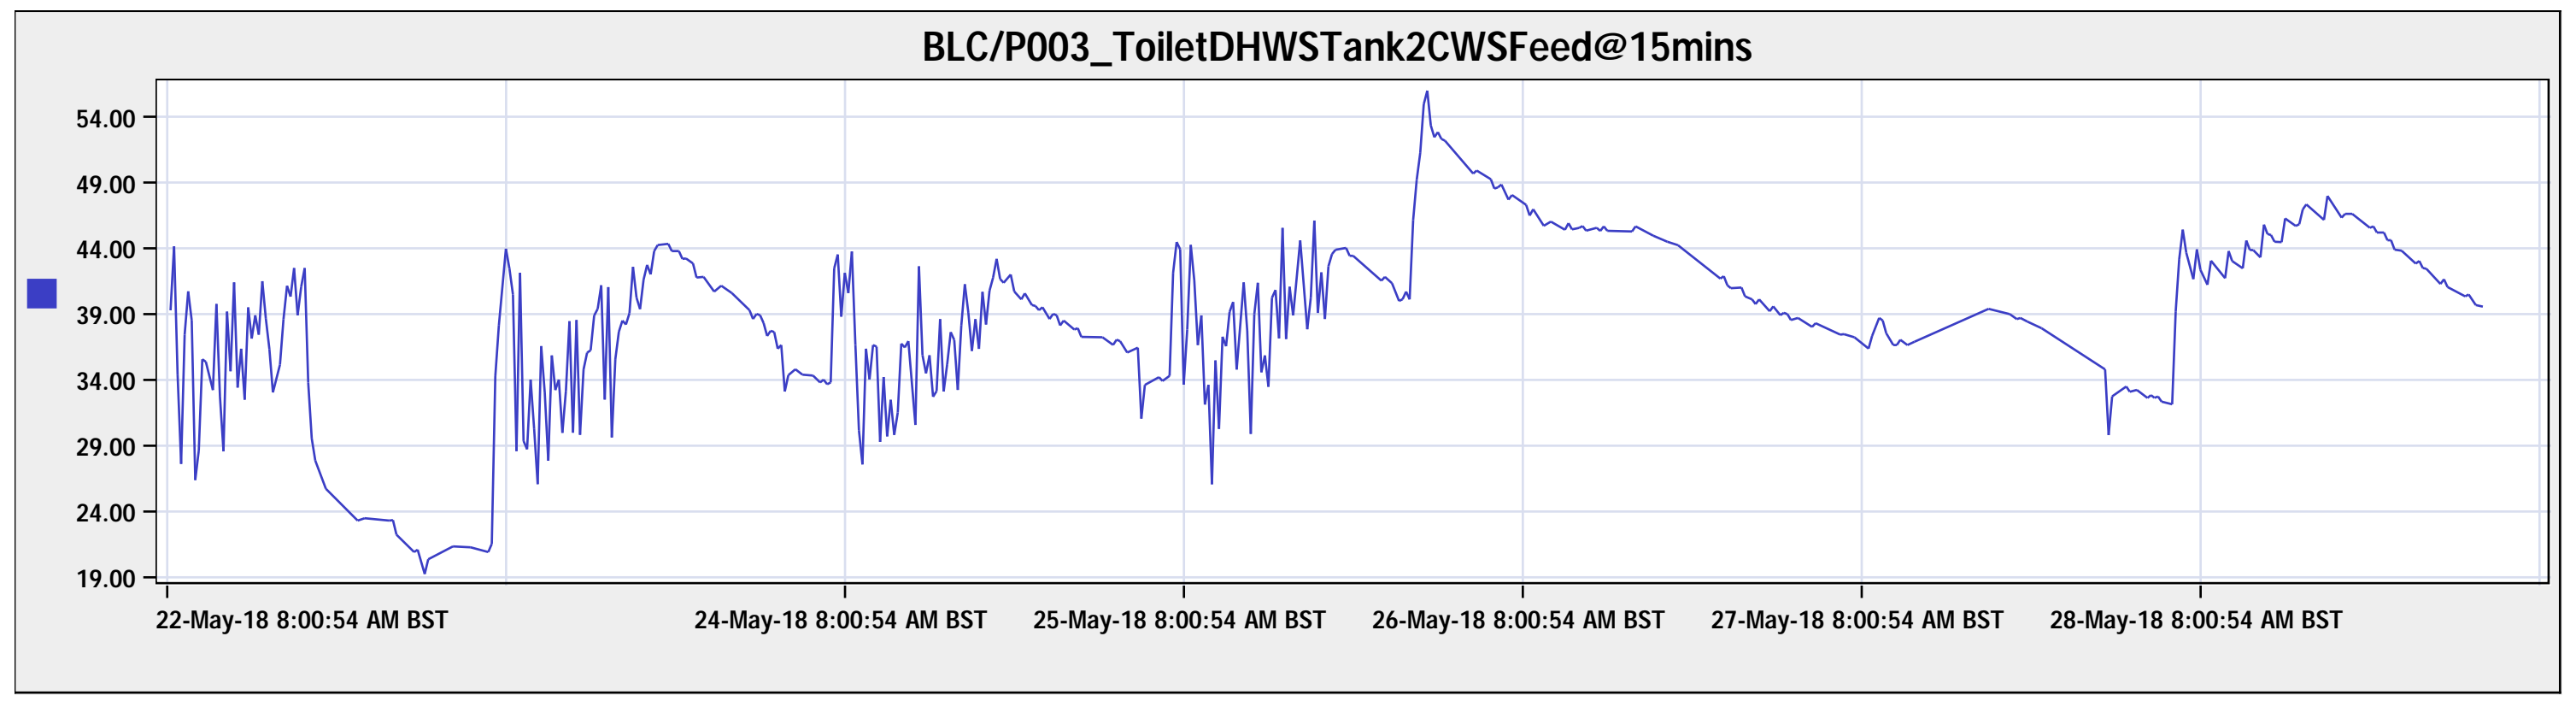

29-May-18 8:00 AM BST